食物業牌照
電子消防安全規定

香港特別行政區政府
消防處

消防處職責

除非申請人已遵行各項規定，包括消防處處長訂立的所有規定，否則發牌當局 (即食物環境衛生署)，不會簽發任何牌照。

消防處所簽發的消防證書，是申請人已遵行各項消防規定的證明文件，亦是簽發食物業牌照的先決條件之一。

消防證書的一般簽發流程

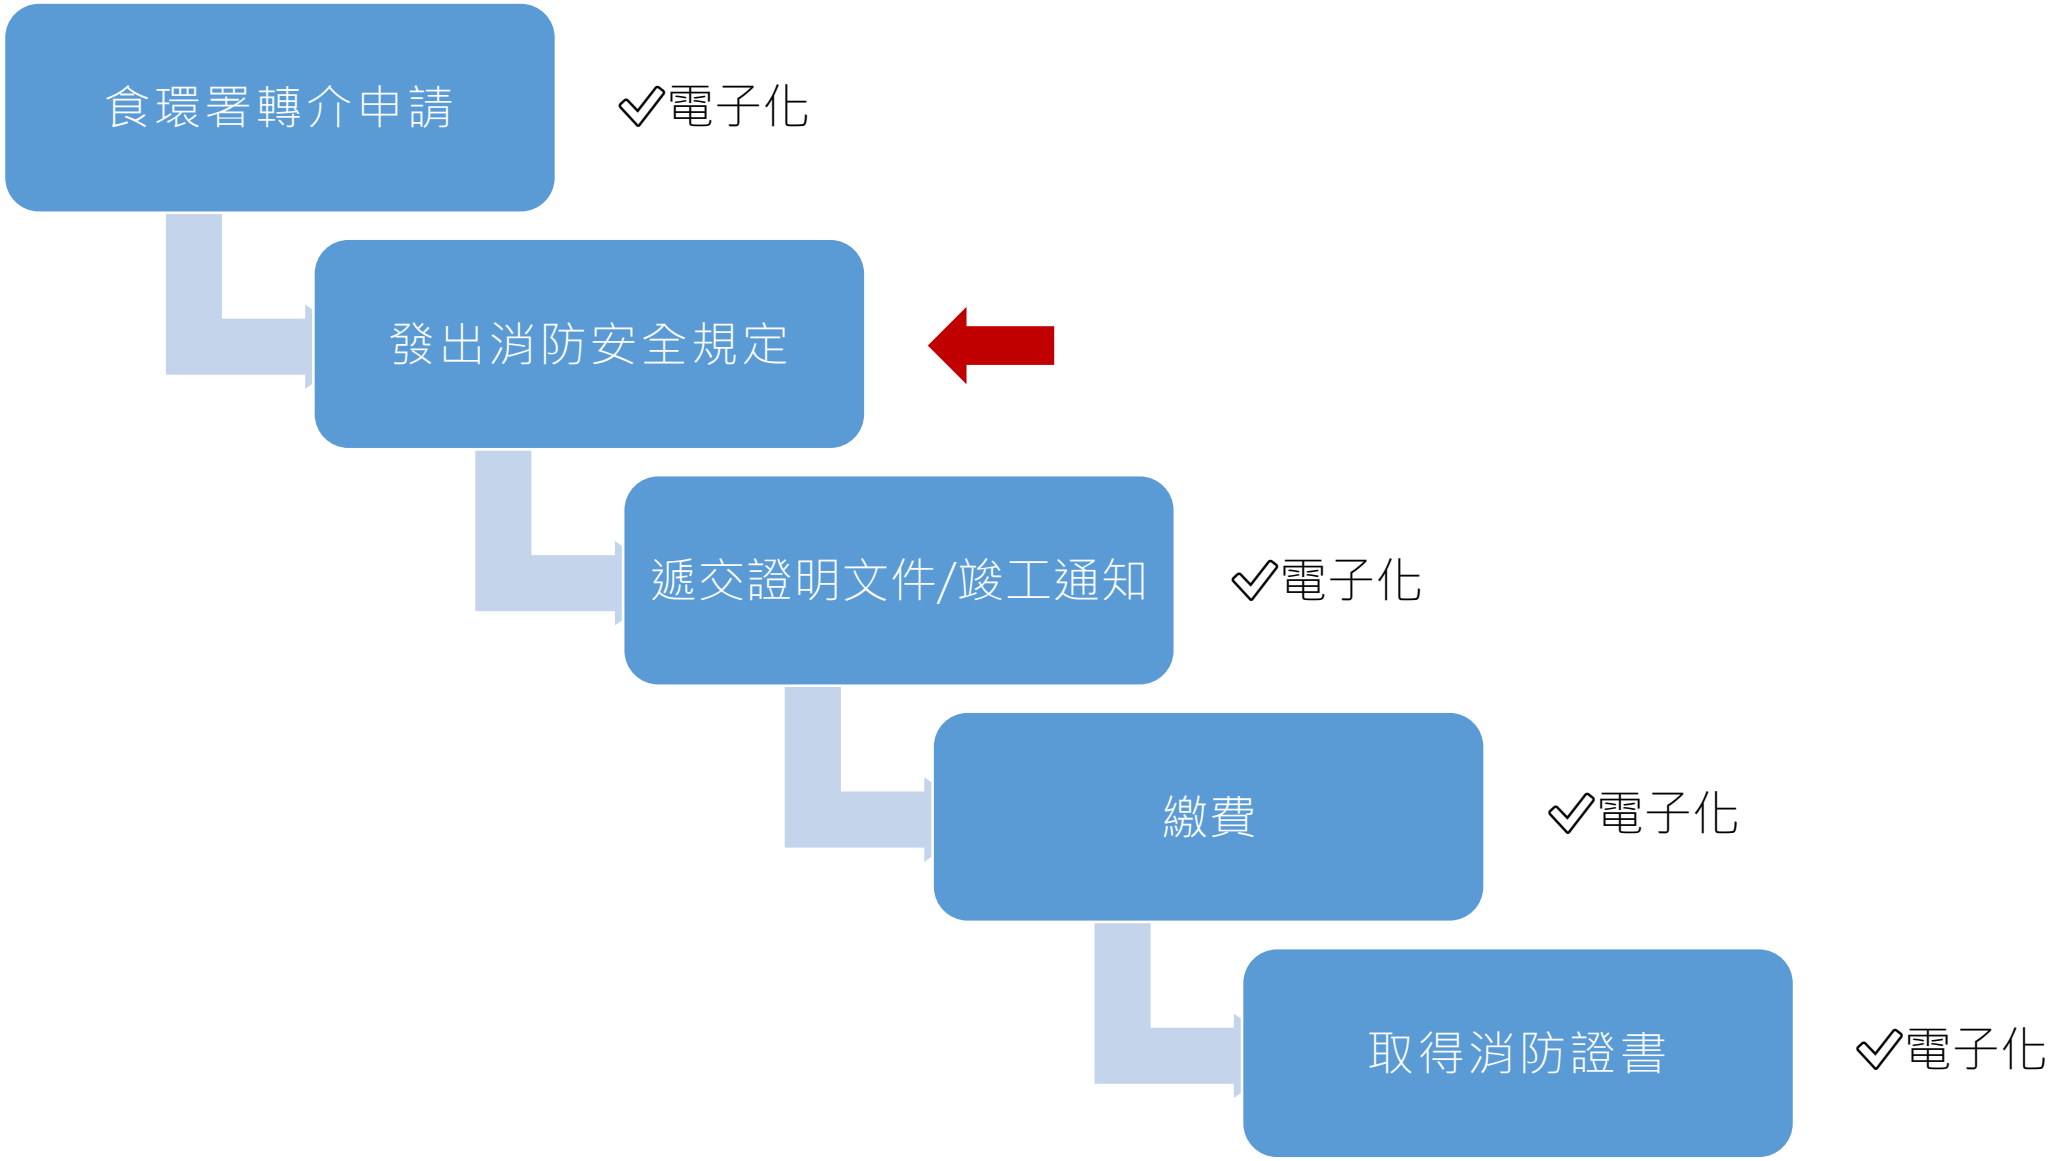

電子消防安全規定

透過郵寄 發送舊有實體紙本 (近100頁)

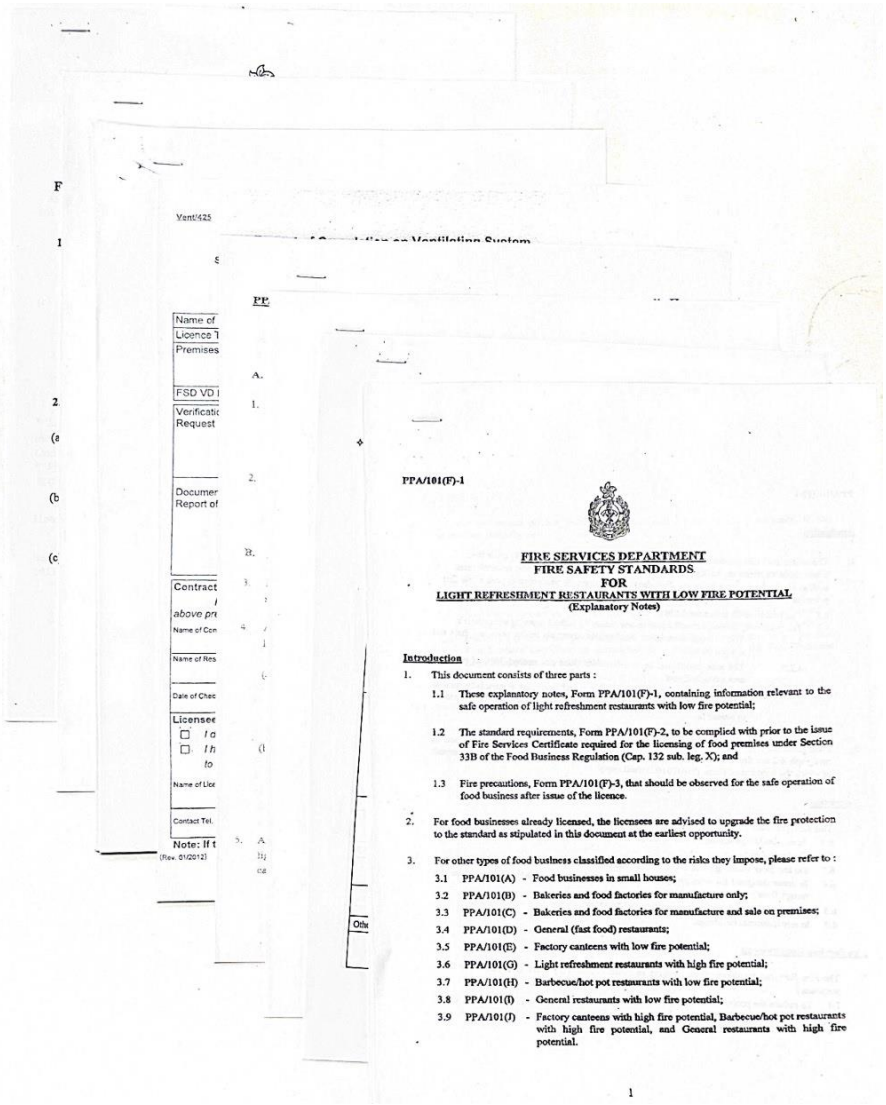

PPA/101(F)-1

FIRE SERVICES DEPARTMENT
FIRE SAFETY STANDARDS
FOR
LIGHT REFRESHMENT RESTAURANTS WITH LOW FIRE POTENTIAL
(Explanatory Notes)

Introduction

1. This document consists of three parts :
   - 1.1 These explanatory notes, Form PPA/101(F)-1, containing information relevant to the safe operation of light refreshment restaurants with low fire potential;
   - 1.2 The standard requirements, Form PPA/101(F)-2, to be complied with prior to the issue of Fire Services Certificate required for the licensing of food premises under Section 33B of the Food Business Regulation (Cap. 132 sub. leg. X); and
   - 1.3 Fire precautions, Form PPA/101(F)-3, that should be observed for the safe operation of food business after issue of the licence.
2. For food businesses already licensed, the licensees are advised to upgrade the fire protection to the standard as stipulated in this document at the earliest opportunity.
3. For other types of food business classified according to the risks they impose, please refer to :
   - 3.1 PPA/101(A) - Food businesses in small houses;
   - 3.2 PPA/101(B) - Bakeries and food factories for manufacture only;
   - 3.3 PPA/101(C) - Bakeries and food factories for manufacture and sale on premises;
   - 3.4 PPA/101(D) - General (fast food) restaurants;
   - 3.5 PPA/101(E) - Factory canteens with low fire potential;
   - 3.6 PPA/101(G) - Light refreshment restaurants with high fire potential;
   - 3.7 PPA/101(H) - Barbecue/hot pot restaurants with low fire potential;
   - 3.8 PPA/101(I) - General restaurants with low fire potential;
   - 3.9 PPA/101(J) - Factory canteens with high fire potential, Barbecue/hot pot restaurants with high fire potential, and General restaurants with high fire potential.

1

透過電郵發送 新電子版本PDF (3-6頁)

FSD Ref.: FP/NT/N6/81111 (#1512345) FSR Appendix

Fire Safety Requirements

Scan / Click to Read

PPA/101(I)
Fire Safety Standards for General Restaurants with Low Fire Potential
Revision: 02/2025

with the following particulars:
Portable fire fighting equipment of the approved type, over and above those installed for the occupation of the building, shall be provided as follows:
- 1 x 9L water type / 5 kg dry powder extinguisher at Seating Area
- 1 x 4.5 kg CO_2 gas type fire extinguisher at Kitchen
- 1 x 1.44 m^2 fire blanket at Kitchen

PPA/102
Requirements for Various Fuels Used in Food Premises
Revision: February 2019

PPA/104(A)
Requirements for Self-Contained Luminaires Emergency Lighting Systems
Revision: May 2021 (5th Revision)

MECHANICAL_VS
Fire Safety Requirements for Mechanical Ventilating Systems
Revision: FSD Circular Letter No. 2/2023

VAC
Fire Safety Requirements for Ventilation / Air-Conditioning Control Systems for Licensed Premises
Revision: February 2019

VS_SCHEDULED_PREMISES
Fire Safety Requirements of Ventilating System for Scheduled Premises
Revision: September 2023

TEMP_HOT_POT
Fire Safety Conditions for Conducting Temporary or Occasional Hot Pot / Food Warming / Flambéing in Seating Accommodation (excluding Outside Seating Accommodation) of General Restaurants / Factory Canteens Using Portable Stove
Revision: 4/2024

Should you have any enquiries, please contact duty staff of the corresponding Licensing Office:
New Territories & Kowloon East Licensing Office — NT: 3423 9328 / nt_lic_1@hkfsd.gov.hk; KE: 3423 9332 / k_lic_3@hkfsd.gov.hk
Hong Kong & Kowloon West Licensing Office — HK: 2589 3310 / h_lic_1@hkfsd.gov.hk; KW: 2302 5339 / k_lic_1@hkfsd.gov.hk

FSR附件

全規定

掃碼 / 點擊閱讀

如有任何疑問，可與以下牌照分區辦事處當值職員聯絡：
牌照組新界及東九龍辦事處 — 新界：3423 9328 / nt_lic_1@hkfsd.gov.hk; 東九龍：3423 9332 / k_lic_3@hkfsd.gov.hk
牌照組香港及西九龍辦事處 — 香港：2589 3310 / h_lic_1@hkfsd.gov.hk; 西九龍：2302 5339 / k_lic_1@hkfsd.gov.hk

on 消防安全規定聲明

In addition, this Department has adopted "Electronic Fire Services Certificate". If you have provided your email address to the relevant Department or this Department when applying, this Department will send the certificate by email after confirming your payment.
此外，本處已採用「電子消防證書」，如你在申請時已向相關部門或本處提供電郵地址，本處在確認你的付款後，將會以電郵方式發送上述消防證書。

電子消防安全規定

消防處檔號：FP/NT/N6/81111 (#1512345)　　FSR附件

消防安全規定

掃碼 / 點擊閱讀

PPA/101(I)
火警風險低的普通食肆的消防安全標準
修訂版本：02/2025

及以下內容：
除安裝在建築物內的消防裝置外，須按下列比例放置屬於認可類型的手提滅火裝備：
- 於 **座位間** 放置 **1** 具9公升裝水式／5公斤乾粉滅火筒
- 於 **廚房** 放置 **1** 具4.5公斤裝二氧化碳滅火筒
- 於 **廚房** 放置 **1** 張1.44平方米的滅火氈

PPA/102
食肆內使用各種燃料的規定
修訂版本：2019年2月

電子消防安全規定

✓節省送遞時間

✓方便查閱

✓節省紙張

前提：申請人已向食環署提供電郵地址

以流動應用程式查詢消防安全規定遵辦進度